


NOTES:

1. PRECAST MANHOLE SECTIONS ARE MANUFACTURED IN LENGTHS OF 1'-4", 2'-8" & 4'-0".
2. THE FIRST TWO SECTIONS BELOW THE TOP SECTION MUST BE 1'-4" LONG ON ALL PROJECTS WITHIN THE CITY OF CORDELE, GA.
3. ALIGN THE ACCESS OPENING ON NONCONCENTRIC TOPS DIRECTLY OVER THE EXIT PIPE OF MANHOLE.
4. THE PREFERRED HEIGHT OF 1'-4" FOR THE BRICK CHIMNEY AND METAL FRAME MAY BE VARIED SLIGHTLY WITH PRIOR APPROVAL OF THE ENGINEER.
5. TOP MUST BE DESIGNED & CONSTRUCTED TO MEET HIGHWAY LOADING FOR TRUCK TRAFFIC.
6. CONCRETE BASE REQUIRED WHERE CLAY PIPE IS INVOLVED. GRAVEL MAY BE USED WITH PVC, CONCRETE, CAST IRON OR DUCTILE IRON PIPE.
7. WHERE TAPS ENTER MANHOLE, NEOPRENE BOOT OR OTHER APPROVED SEALING METHOD REQUIRED. NEOPRENE BOOT OR OTHER APPROVED SEALING METHOD REQUIRED AT PIPE ENTRY.

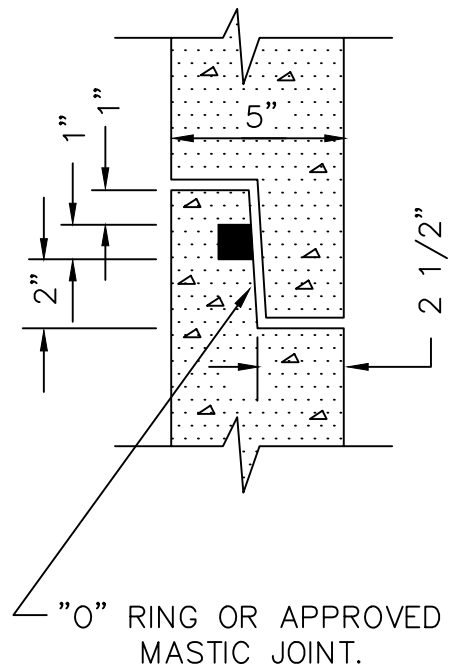

**CITY OF CORDELE, GEORGIA - STANDARD DETAIL**

STANDARD PRECAST STORM  
OR SANITARY MANHOLE

DETAIL NO:

S-002

DATE: OCT 2018