


NOTE: TOP MUST BE DESIGNED & CONSTRUCTED TO MEET HIGHWAY LOADING FOR TRUCK TRAFFIC.

GUTTER WIDTH VARIES SEE PLAN FOR LOCATION

USF 5130-6016 CASTING

ADJUST TO GRADE AS REQUIRED.

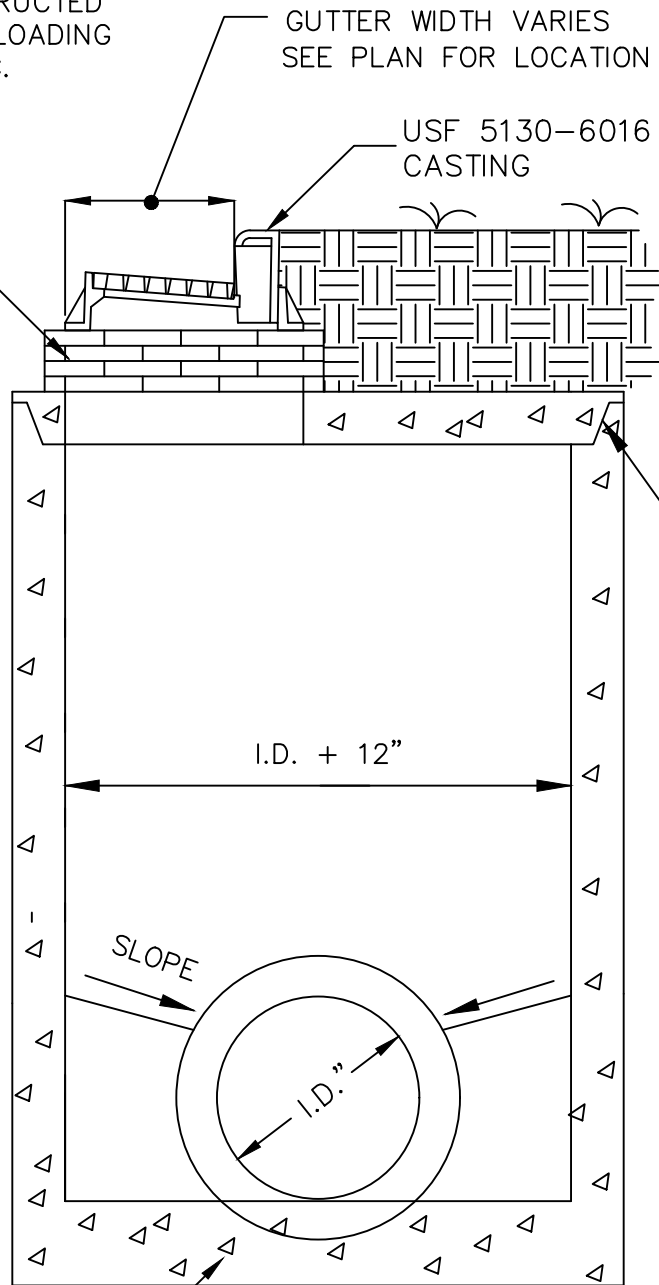

SEAL JOINT WITH PLASTIC BITUMASTIC SEALER.

I.D. + 12"

SLOPE

I.D."

PRECAST STRUCTURE
 CIRCULAR MEETS ASTM C-478 REQUIREMENTS
 RECTANGULAR MEETS ASTM C-890 & C-913 REQUIREMENTS.



CITY OF CORDELE, GEORGIA - STANDARD DETAIL

SHALLOW MANHOLE STORM SEWER SYSTEM

DETAIL NO:

D-017

DATE: