


PLAN



ELEVATION

- NOTE: 1. SERVICE CLAMP REQUIRED ON ALL CONNECTIONS TO PVC WATER MAIN AND ON CONNECTIONS LARGER THAN 1" DIAM. TO DIP WATER MAIN.
2. FOR 1" & LARGER SERVICES, INSTALL DUAL CHECK VALVE IN SEPARATE METER BOX.

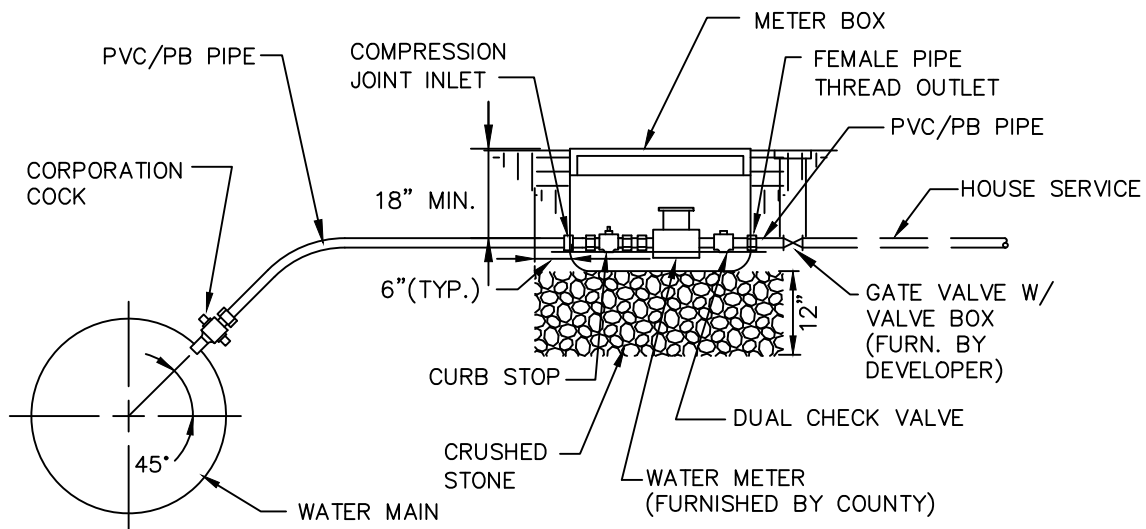

CITY OF CORDELE, GEORGIA - STANDARD DETAIL

**WATER SERVICE &
METER CONNECTION**

DETAIL NO:

W-007

DATE: